




Regulator Dialog 2 IVT

Zunanja enota




IVT Ax-09

RJ45 pogled od spredaj (Top view)

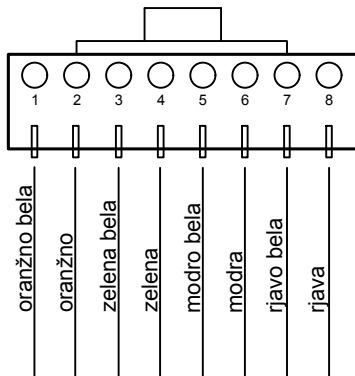

Varnostni senzor temperature zunaj na cevi

UTP ali FTP

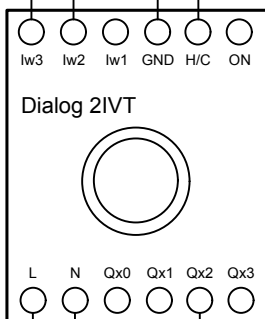

LEGENDA:

Zunanja enota IVT AX-09:

Konektor A:

Konektor B:

Senzor temperature zunaj na cevi

Regulator Dialog 2IVT:

Konektor RJ45:

lw3: Vklon / Izklop (sobni termostat)

lw2: Senzor zelene temperature vode

H/C: Izbira delovanja (grej / hladi)

L, N Napajalna napetost 230VAC

Qx3: izhod za obtočno črpalko

▲	/ /		
▲	/ /		
▲	/ /		
▲	/ /		
▲	/ /		
	Datum	Spremembe	Ime

Dialog 2IVT -> zunanja enota TČ IVT

Prof.el d.o.o. Metina ulica 1 2000 Maribor

Izdelal:

I.Godec

Pregledal:

I. Godec

Naročnik:

Info:

Datum


01 / 12 / 18

Stran

1 / 1

Ime projekta:

Načrt povezave

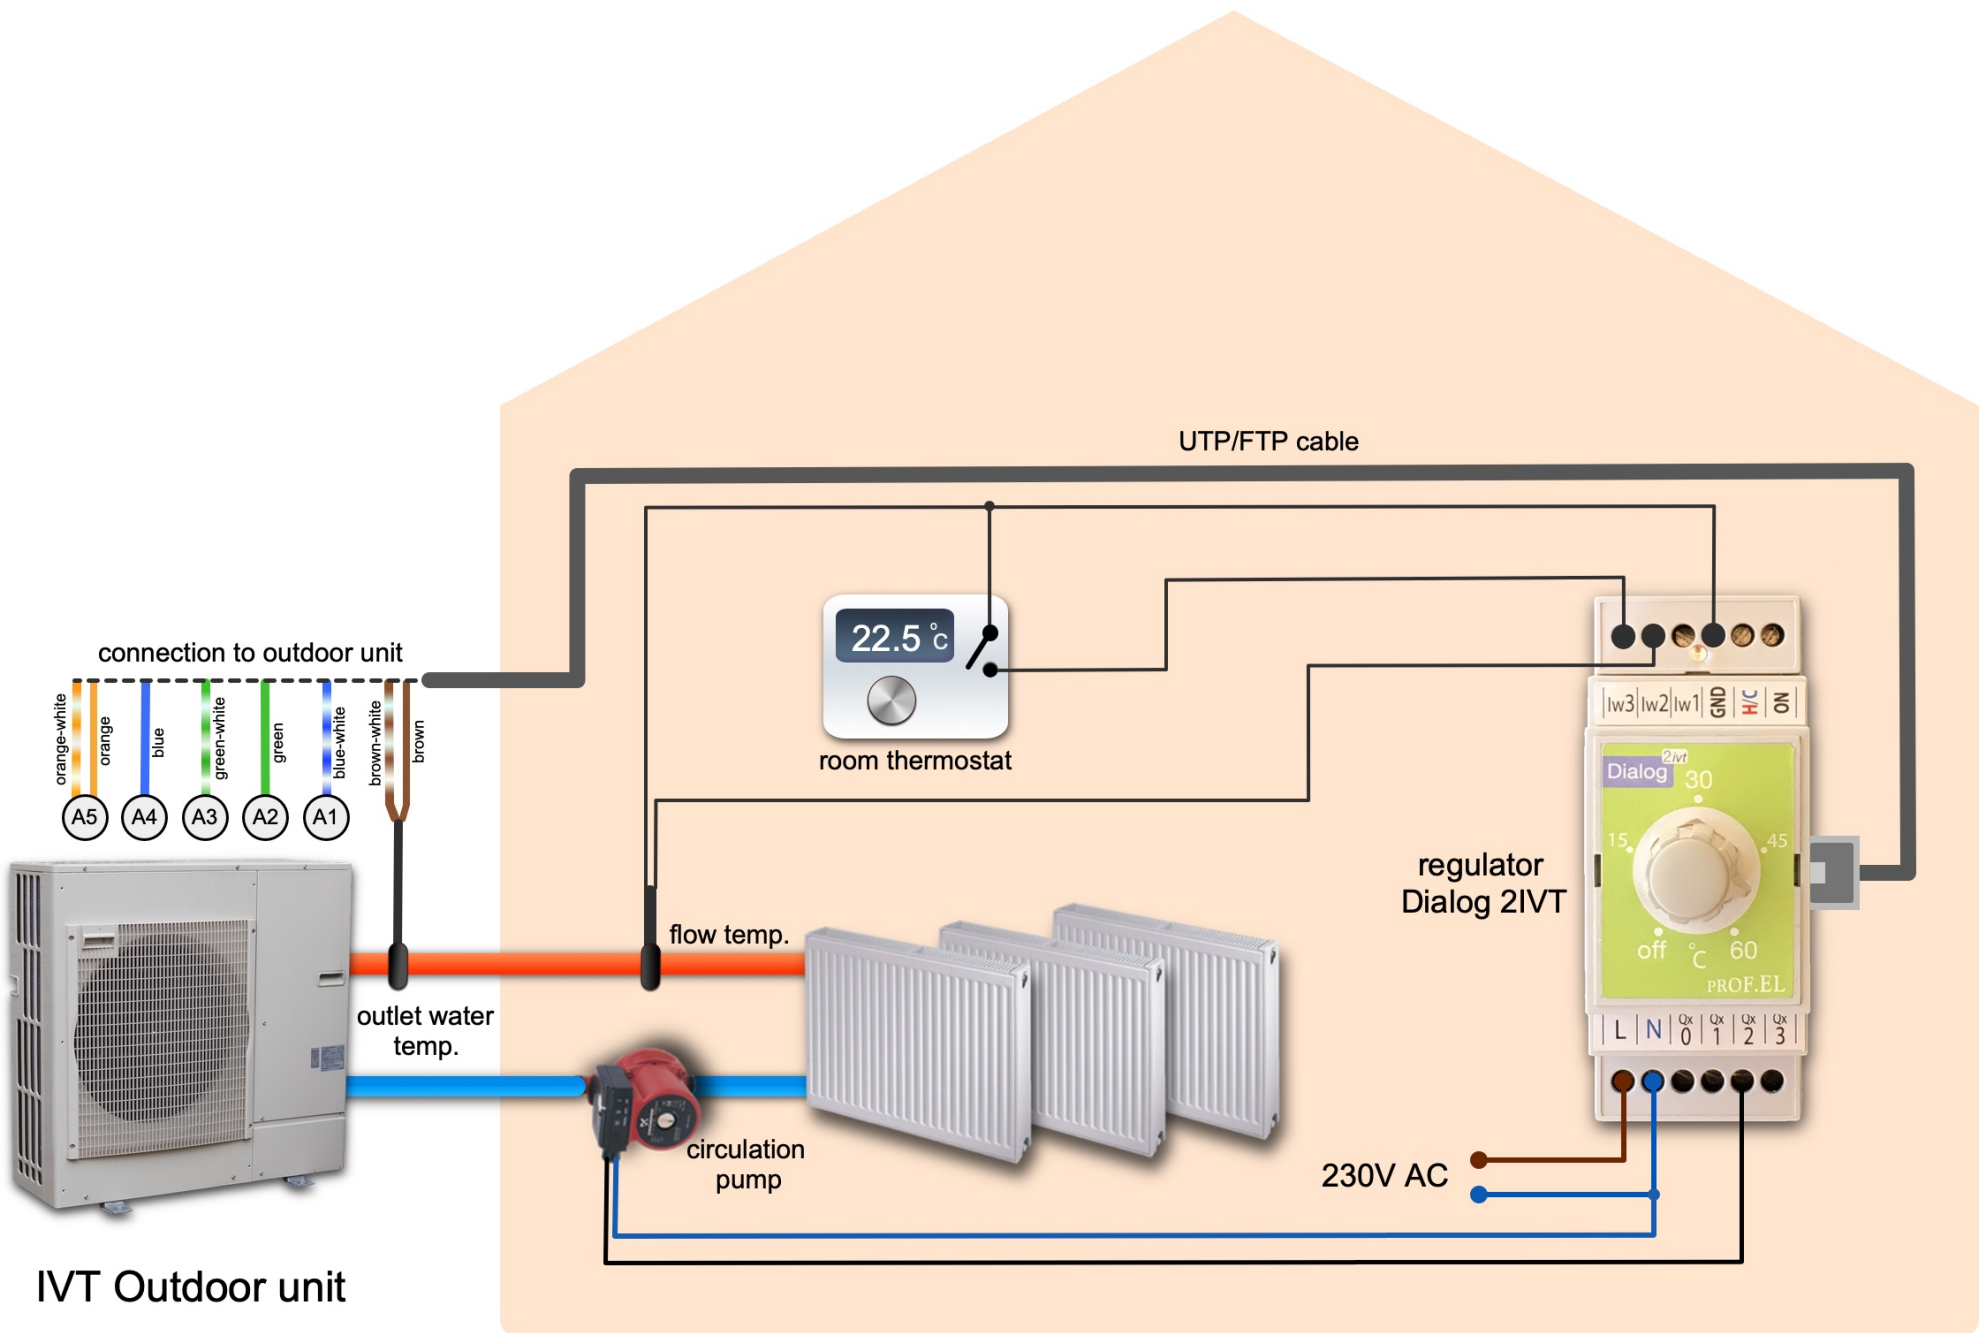

UTP/FTP cable

connection to outdoor unit

- orange-white (A5)
- orange (A4)
- blue (A3)
- green-white (A2)
- green (A1)
- blue-white
- brown-white
- brown



room thermostat

regulator Dialog 2IVT



flow temp.

outlet water temp.

circulation pump

230V AC

IVT Outdoor unit